


# ODS-750

## 450...750W DC/AC SINE WAVE INVERTER

### GENERAL FEATURES:

- Sine wave output voltage
- Selectable output frequency: 50/60Hz
- High input-output isolation 3000Vrms
- Remote inhibit
- Input and output alarm
- Railway version EN50155, RIA12 (optional)
- Fire and smoke: EN45545-2 approved



|        | 12Vdc<br>9.5 ... 15V        | 24Vdc<br>16.8 ... 30V       | 36Vdc<br>25.2 ... 45V       | 48Vdc<br>33.6 ... 60V       | 72Vdc<br>50.4 ... 90V       | 110Vdc<br>77 ... 138V       |
|--------|-----------------------------|-----------------------------|-----------------------------|-----------------------------|-----------------------------|-----------------------------|
| 120Vac | <b>ODS-750-7281</b><br>450W | <b>ODS-750-7283</b><br>750W | <b>ODS-750-7284</b><br>750W | <b>ODS-750-7285</b><br>750W | <b>ODS-750-7286</b><br>750W | <b>ODS-750-7287</b><br>750W |
| 230Vac | <b>ODS-750-7271</b><br>450W | <b>ODS-750-7273</b><br>750W | <b>ODS-750-7274</b><br>750W | <b>ODS-750-7275</b><br>750W | <b>ODS-750-7276</b><br>750W | <b>ODS-750-7277</b><br>750W |

Several references are subjected to special MOQs and lead times. Please consult Premium's Sales Dept. and web site.



| <b>INPUT</b>                                 |  |
|--|--|
| Input voltage range                          | See table  |
| Maximum input ripple                         | 5% Vin nom (Vrms, 100Hz)   |
| <b>OUTPUT</b>                                |  |
| Nominal output voltage                       | 120 / 230Vac sinusoidal according to EN50160   |
| Output voltage factory adjustment tolerance  | +2%, -0% at no load  |
| Output voltage adjustment range              | 110...120 / 220...230 Vac<br>120 / 230 Vac (Default)<br>110 / 220 Vac (Option J)   |
| Load regulation                              | < 4%   |
| Line regulation                              | 0.4% @ ΔVin -20 ... +25%<br>10% @ ΔVin -30 ... +25%<br>1% @ ΔVin -10 ... +25% for 12Vin models<br>10% @ ΔVin -20 ... +25% for 12Vin models |
| Output frequency                             | 50 / 60Hz ± 0.25Hz   |
| Output wave distortion THD                   | < 2% (16 samples average)  |
| Output voltage HF ripple                     | < 20Vpp  |
| <b>ENVIRONMENTAL</b>                         |  |
| Storage temperature                          | -40 ... 85°C   |
| Operating temperature full load              | -40 ... 55°C   |
| Operating temperature 62.5% load             | -40 ... 70°C   |
| Altitude                                     | 0 ... 1800m  |
| Cooling                                      | Variable speed internal fan  |
| MTBF (MIL-HDBK-217-E; G <sub>b</sub> , 25°C) | 160.000 h  |
| <b>EMC</b>                                   |  |
| Immunity according to                        | EN61000-6-2 / EN50121-3-2  |
| Emissions according to                       | EN61000-6-4 / EN50121-3-2  |
| <b>SAFETY</b>                                |  |
| Safety according to                          | IEC62368-1: 2018   |
| Dielectric strength: Input /output           | 3000 Vrms / 50Hz / 1min  |
| Dielectric strength: Output / Earth          | 1500 Vrms / 50Hz / 1min  |
| Dielectric strength: Input / Earth           | 1500 Vrms / 50Hz / 1min  |
| Fire and smoke                               | EN45545-2 approved   |
| <b>MECHANICAL</b>                            |  |
| Weight                                       | 1950 g   |
| Dimensions                                   | 130 x 270 x 50mm   |
| <b>PROTECTIONS</b>                           |  |
| Against input over-currents                  | Internal fuse for 36, 48, 72, and 110V input models  |
| Against output overloads < 10A               | Linear   |
| Against output overloads > 10A               | Triggered  |
| Against over-temperature                     | Shutdown with automatic recovery   |
| <b>CONTROL</b>                               |  |
| Remote inhibit input                         | OFF: applying 4 ... 24 Vdc, Impedance >3k3Ω  |
| Input and output alarm                       | Isolated contact relay open when alarm (< 0.1A at 150Vcc)  |




## ORDERING CODES

| MODEL               | DC Input |                    |      |               |            |      | AC Output |         |      |        |        | Efficiency<br>Full<br>load<br>[%] |
|---------------------|----------|--------------------|------|---------------|------------|------|-----------|---------|------|--------|--------|-----------------------------------|
|                     | Voltage  |                    |      |               | Current    |      | Voltage   | Current |      | Power  |        |                                   |
|                     | Nom.     | Min.               | Max. | Max.<br>RIA12 | No<br>Load | Max. | Default   | Cont.   | 10ms | Active | Appar. |                                   |
|                     | [V]      | [V]                | [V]  | [V]           | [A]        | [A]  | [V]       | [A]     | [A]  | [W]    | [VA]   |                                   |
| <b>ODS-750-7271</b> | 12       | 9.5 <sup>(1)</sup> | 15   | -             | 0.80       | 55.7 | 230       | 2.0     | 10   | 450    | 750    | 85                                |
| <b>ODS-750-7273</b> | 24       | 16.8               | 30   | 33.6          | 0.46       | 51.9 | 230       | 3.26    | 10   | 750    | 750    | 86                                |
| <b>ODS-750-7274</b> | 36       | 25.0               | 45   | 50.4          | 0.36       | 34.5 | 230       | 3.26    | 10   | 750    | 750    | 87                                |
| <b>ODS-750-7275</b> | 48       | 33.6               | 60   | 67.2          | 0.27       | 25.4 | 230       | 3.26    | 10   | 750    | 750    | 88                                |
| <b>ODS-750-7276</b> | 72       | 50.4               | 90   | 100.8         | 0.17       | 16.9 | 230       | 3.26    | 10   | 750    | 750    | 88                                |
| <b>ODS-750-7277</b> | 110      | 77.0               | 138  | 154           | 0.12       | 11.1 | 230       | 3.26    | 10   | 750    | 750    | 89                                |
| <b>ODS-750-7281</b> | 12       | 9.5 <sup>(1)</sup> | 15   | -             | 0.80       | 56.4 | 120       | 3.75    | 16   | 450    | 750    | 84                                |
| <b>ODS-750-7283</b> | 24       | 16.8               | 30   | 33.6          | 0.46       | 51.9 | 120       | 6.26    | 16   | 750    | 750    | 86                                |
| <b>ODS-750-7284</b> | 36       | 25.0               | 45   | 50.4          | 0.36       | 34.5 | 120       | 6.26    | 16   | 750    | 750    | 87                                |
| <b>ODS-750-7285</b> | 48       | 33.6               | 60   | 67.2          | 0.27       | 25.4 | 120       | 6.26    | 16   | 750    | 750    | 87                                |
| <b>ODS-750-7286</b> | 72       | 50.4               | 90   | 100.8         | 0.17       | 16.9 | 120       | 6.26    | 16   | 750    | 750    | 87                                |
| <b>ODS-750-7287</b> | 110      | 77.0               | 138  | 154           | 0.12       | 11.1 | 120       | 6.26    | 16   | 750    | 750    | 88                                |

Several references are subjected to special MOQs and lead times. Please consult Premium's Sales Dept. and web site.


NOTE <sup>(1)</sup>: Start up voltage ≤ 10.2V. Undervoltage shutdown < 9.5V

ODS-750-72 \_ \_ - \_ \_ \_

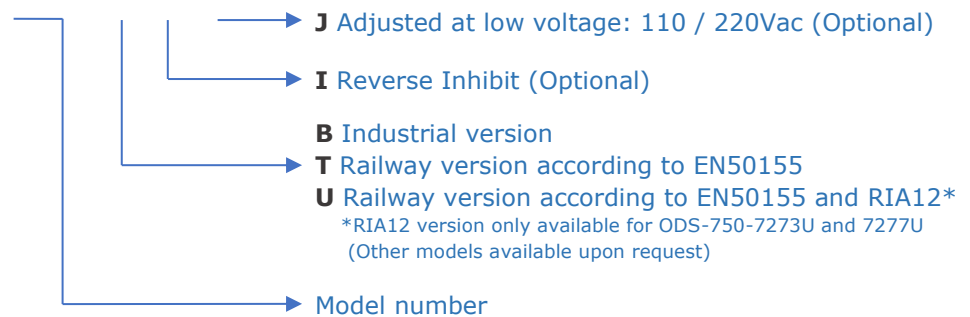


Accessories must be ordered in a separated order line

## BLOCKS DIAGRAM

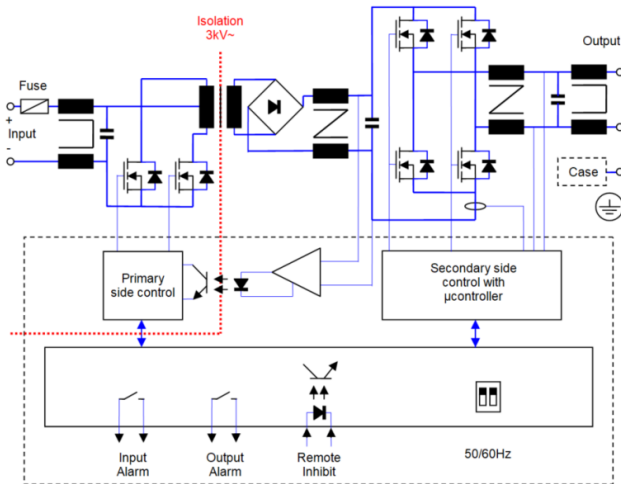


## CONNECTIONS

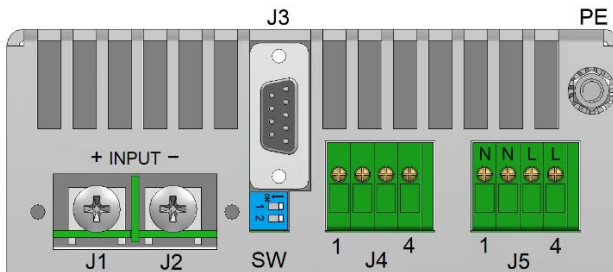

|           |           |                                 |                              |              |     |
|-----------|-----------|---------------------------------|------------------------------|--------------|-----|
| J1        | +Vin      | Terminals M5                    | J3 - 1                       | Input Alarm  | DB9 |
| J2        | -Vin      | Rec. torque 4Nm                 | J3 - 2                       | Input Alarm  |     |
| J5 - 1, 2 | N Output  | Cables up to 2.5mm <sup>2</sup> | J3 - 4                       | Output Alarm |     |
| J5 - 3, 4 | L Output  |                                 | J3 - 5                       | Output Alarm |     |
| J4 - 1    | + Inhibit | SW - 1                          | On 60Hz, Off 50Hz            |              |     |
| J4 - 2    | - Inhibit | SW - 2                          | N/A                          |              |     |
| J4 - 3, 4 | N/C       | PE                              | Stud M5<br>Rec. torque 3.8Nm |              |     |

## POWER DERATING vs AMBIENT TEMPERATURE

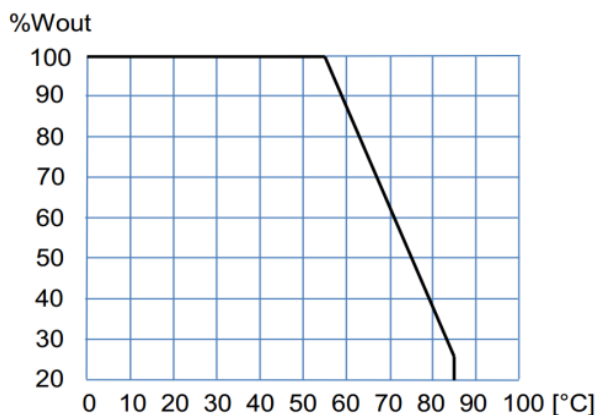

## DESCRIPTION

The ODS 750 is a single phase pure sinewave DC-AC inverter with galvanic isolation between input and output.

The following items can be set on the unit:

- The output frequency can be set through the dip-switch 1.
- The unit can be remotely activated or deactivated through the remote inhibit input.

Protections of the ODS-750:

- Reverse polarity protection of the input by fuse.
- Input under voltage: The unit shutdown when the input voltage is below its limit (see the limits on the models table)
- Overloads protection: The output has protection of maximum average power and maximum peak current. The unit shutdowns when the operation curve limit is exceeded for more than one second. Every 2 seconds after shutdown, the unit tries to restart up to 3 times. If the overload persists, the unit remains shutdown until an input reconnection.

## INSTALLATION

- The device includes 10 M3 threaded holes that allows different mounting positions. For other mounting solutions see the accessories.
- Make connections according to connections drawing and table.
- The default output frequency is 50Hz. For 60Hz simply actuate the dip-switch as indicated in the figure.
- The inverter includes active overload protection but does not provide protection against prolonged reactive overload conditions. Therefore, the maximum power output (VA) should not be exceeded.
- The EMC output filter is connected to the case, which causes a leakage current lower than 1mA. In order to prevent any touch current, connect the case to earth by means of any mounting hole.
- Since the output is floating, it does not require the use of an RCD (residual current device) to ensure safety against contact with the output.


If for any reason a RCD is used, it is necessary to connect the output neutral to ground for its proper operation.

A Type-A RCD is sufficient, as the design of the inverter prevents the output from having dangerous DC or mixed-frequency components.




## OPERATION CURVE LIMIT

Models of 230V output

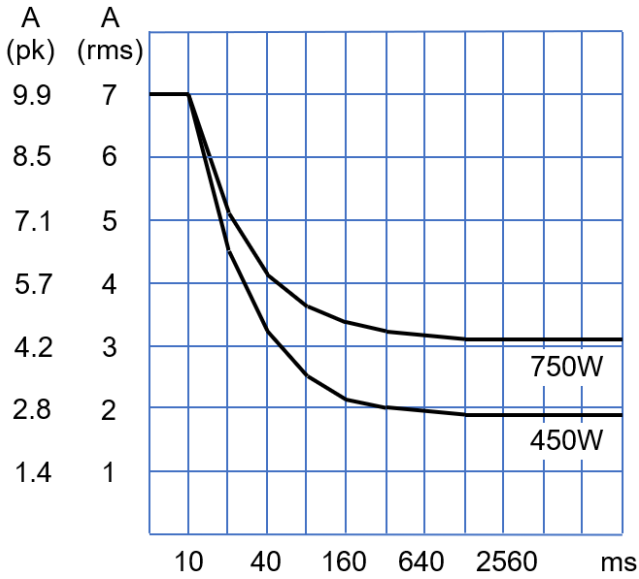

Models of 120V output

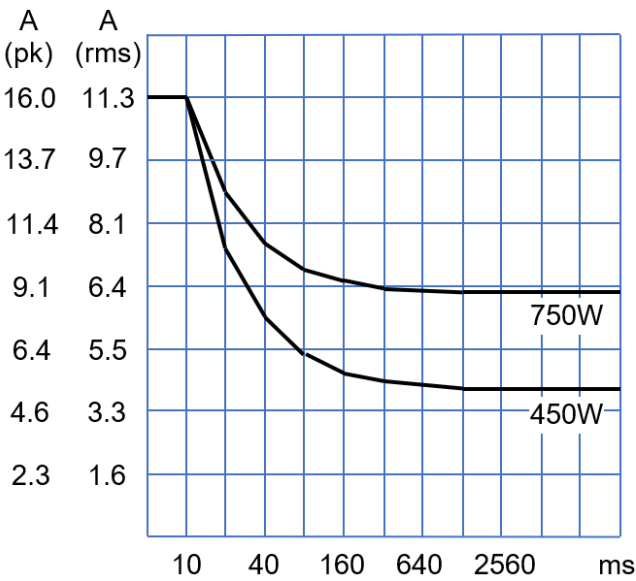


**For safety reasons, the following requirements must be met:**

- Provide the equipment with some kind of protective enclosure that complies with the electrical safety directives in effect within the country where the equipment is installed.
- Add an external fuse of 60A and 50A for the models of input voltage 12V and 24V respectively.
- Use cables of adequate cross-section to connect inputs and outputs. The following table lists the maximum currents and the minimum cross-sections for the cables used for each power connection.

|                                  | Input 12V | Input 24V | Input 36V | Input 48V | Input 72V | Input 110V | Output 120V | Output 230V |
|----------------------------------|-----------|-----------|-----------|-----------|-----------|------------|-------------|-------------|
| Max. Current [A]                 | 60        | 50        | 33        | 25        | 17        | 12         | 6.7         | 3.5         |
| Cable section [mm <sup>2</sup> ] | 10        | 10        | 6         | 2.5       | 2.5       | 1.5        | 1           | 0.75        |



## DIMENSIONS

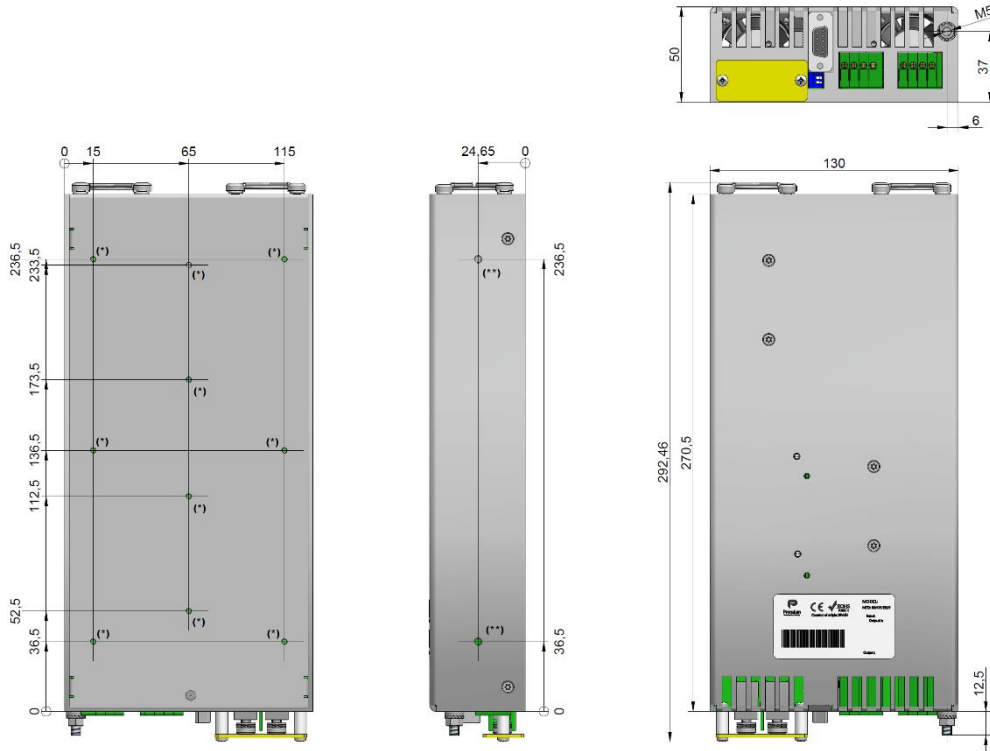

(\* ) M3 threaded hole. Maximum screw depth: 3mm (For DIN rail clips)  
(\*\*) M4 threaded hole. Maximum screw depth: 4.5mm (For fixing)


## ACCESSORIES

| ACCESSORIES                                 | NOTES                                       | CODE           |
|---|---|----------------|
| DIN RAIL CLIP                               | Screws included. Order 2 units per inverter | <b>NP-9135</b> |
| Mounting base                               | Screws included                             | <b>NP-9265</b> |
| Mechanical Interface for subrack of 6U 11Te | Screws included                             | <b>NP-9366</b> |




**NP-9135**



**NP-9265**

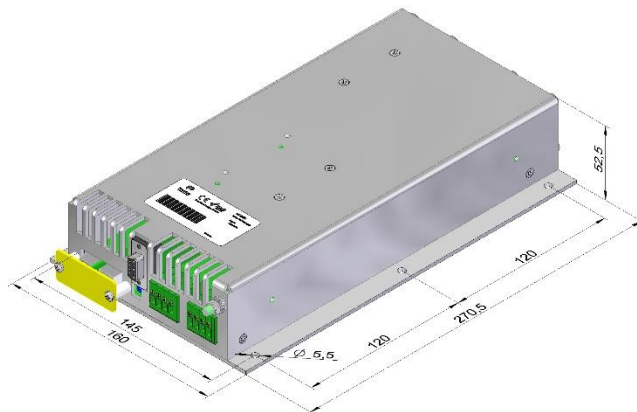

**NP-9366**

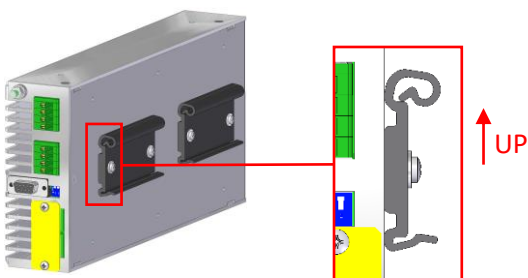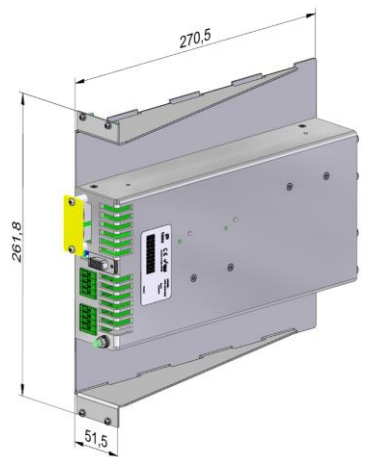



## CE EU DECLARATION OF CONFORMITY

The undersigned, representing the following:

Manufacturer: PREMIUM, S. A.,

Address: C/. Dolors Aleu 19-21, 08908 L'Hospitalet de Llobregat, SPAIN

herewith declares that the products:

Type: **DC/AC Inverter**

Brand: **Premium**

Models: **ODS-750-7281, ODS-750-7283, ODS-750-7284, ODS-750-7285, ODS-750-7286, ODS-750-7287, ODS-750-7271, ODS-750-7273, ODS-750-7274, ODS-750-7275, ODS-750-7276, ODS-750-7277**  
with any of the suffixes **B, T, U** or **J**

is in conformity with the provisions of the following EU directive(s):

|   |  |
|---|--|
| 2014/35/EU  | Low voltage / The electrical equipment (safety) regulations  |
| 2014/30/EU  | EMC / Electromagnetic compatibility regulations  |
| 2011/65/EU Annex II and its amendment 2015/863/EU | RoHS / Restriction of the use of certain hazardous substances in electrical and electronic equipment |

This declaration applies to all specimens manufactured identical to the samples submitted for testing/evaluation.

Assessment of compliance of the product with the requirements relating to aforementioned directives, was performed by Premium S.A. and is based on the following standards:

|                             |  |
|-----------------------------|--|
| EN IEC62368-1:2020 A11:2020 | Safety. Audio/video information and communication technology equipment   |
| EN IEC61000-6-4:2019        | Generic emission standard  |
| EN IEC61000-6-2:2019        | Generic Immunity standard  |
| EN IEC63000:2018            | Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances |
| EN50155: 2017*              | Railway applications. Electronic equipment used on rolling stock material  |
| EN50121-3-2: 2016*          | Railway applications. EMC Rolling stock equipment  |
| EN50121-4: 2016*            | Railway applications. EMC of the signalling and telecommunications apparatus   |

\* Optional, see annexe

CE marking year: **2006**

### Notes:

For the fulfilment of this declaration the product must be used only for the aim that has been conceived, considering the limitations established in the instruction manual or datasheet.

L'Hospitalet de Llobregat, 28-06-2024

Manuel Camacho  
Technical Director

**PREMIUM S.A.** is an ISO9001 and ISO14001  
certified company by **Bureau Veritas**



## UKCA DECLARATION OF CONFORMITY

The undersigned, representing the following:

Manufacturer: PREMIUM, S. A.,

Address: C/. Dolors Aleu 19-21, 08908 L'Hospitalet de Llobregat, SPAIN

herewith declares that the products:

Type: **DC/AC Inverter**

Brand: **Premium**

Models: **ODS-750-7281, ODS-750-7283, ODS-750-7284, ODS-750-7285, ODS-750-7286, ODS-750-7287, ODS-750-7271, ODS-750-7273, ODS-750-7274, ODS-750-7275, ODS-750-7276, ODS-750-7277**  
with any of the suffixes **B, T, U** or **J**

Complies with the essential protection requirements of the following regulations:

|                  |  |
|------------------|--|
| SI 2016 No 1101  | Low voltage / The electrical equipment (safety) regulations  |
| SI 2016 No 1091  | EMC / Electromagnetic compatibility regulations  |
| SI 2012 No. 3032 | RoHS / Restriction of the use of certain hazardous substances in electrical and electronic equipment |

This declaration applies to all specimens manufactured identical to the samples submitted for testing/evaluation.

Assessment of compliance of the product with the requirements relating to aforementioned regulations, was performed by Premium S.A. and is based on the following standards:

|                             |  |
|-----------------------------|--|
| EN IEC62368-1:2020 A11:2020 | Safety. Audio/video information and communication technology equipment   |
| EN IEC61000-6-4:2019        | Generic emission standard  |
| EN IEC61000-6-2:2019        | Generic Immunity standard  |
| EN IEC63000:2018            | Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances |
| EN50155: 2017*              | Railway applications. Electronic equipment used on rolling stock material  |
| EN50121-3-2: 2016*          | Railway applications. EMC Rolling stock equipment  |
| EN50121-4: 2016*            | Railway applications. EMC of the signalling and telecommunications apparatus   |
| RIA-12*                     | Protection of electronic equipment from transients & surges in DC Control Systems  |

\* Optional, see annexe

UKCA marking year: **2021**

### Notes:

For the fulfilment of this declaration the product must be used only for the aim that has been conceived, considering the limitations established in the instruction manual or datasheet.

L'Hospitalet de Llobregat, 22-04-2025

Manuel Camacho  
Technical Director

**PREMIUM S.A.** is an ISO9001 and ISO14001  
certified company by **Bureau Veritas**



## ANNEXE-1

| Applicable values for the different sections of the norm EN50155: 2017 |   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|--|---|--|---------------------|--------------------------|--------------------|----------------------------|---------------------|--------------------|-------------------------|--------------|--------------------------------|-----------------------|---------------------------------|-----------------------|-----------------|----------------------------|-------------------------|-------------------------|---------------------|----------|--|-----------------|--------------|--------------------------|-------------------------------|--------------------------|------------------------------------|-----------------------------|-------------------------------------|--------------|-------|------|----------------|---|--------|------|--------|------|----|------|-------|--------------|--------------|------|-----------------|---|---------------|------|--------------|--------------|-------|-----|--------------------------|---|--------|-----|--------|-----|----|-----|----------------|--------------|------------|--------|----------------------|---|----------------------|--------------|------------|--------|-----------------|---|
| 4.3.1  | Working altitude                                      | Up to 1800m  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4.3.2  | Ambient temperature                                   | Class OT2 (-40 to 55°C): load < 100%<br>Class OT4 (-40 to 70°C): load < 62.5%  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4.3.3  | Switch-on extended operating temp.                    | ST1  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4.3.4  | Rapid temperature variations                          | H1   |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4.3.5  | Shocks and vibrations                                 | According EN61373:2010 Category 1 class B  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4.3.6  | EMC Electromagnetic Compatibility<br>EN50121-3-2:2016 | <table border="1"> <thead> <tr> <th>Test</th> <th>Norm</th> <th>Port</th> <th>Frequency</th> <th>Limits</th> </tr> </thead> <tbody> <tr> <td rowspan="4">Radiated emissions</td> <td rowspan="4">IEC55016</td> <td rowspan="4">Case</td> <td>30MHz...230MHz</td> <td>40dB(µV/m) Qpk at 10m</td> </tr> <tr> <td>230MHz...1GHz</td> <td>47dB(µV/m) Qpk at 10m</td> </tr> <tr> <td>1...3GHz</td> <td>Do not apply</td> </tr> <tr> <td>3...6GHz</td> <td>Internal freq. &lt; 108MHz</td> </tr> <tr> <td rowspan="2">Conducted emissions</td> <td rowspan="2">IEC55016</td> <td rowspan="2">Input</td> <td>150kHz...500kHz</td> <td>99dB(µV) Qpk</td> </tr> <tr> <td>500kHz...30MHz</td> <td>93dB(µV) Qpk</td> </tr> </tbody> </table>  | Test                | Norm                     | Port               | Frequency                  | Limits              | Radiated emissions | IEC55016                | Case         | 30MHz...230MHz                 | 40dB(µV/m) Qpk at 10m | 230MHz...1GHz                   | 47dB(µV/m) Qpk at 10m | 1...3GHz        | Do not apply               | 3...6GHz                | Internal freq. < 108MHz | Conducted emissions | IEC55016 | Input                                  | 150kHz...500kHz | 99dB(µV) Qpk | 500kHz...30MHz           | 93dB(µV) Qpk                  |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Test   | Norm                | Port                     | Frequency          | Limits                     |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Radiated emissions   | IEC55016            | Case                     | 30MHz...230MHz     | 40dB(µV/m) Qpk at 10m      |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   |  |                     |                          | 230MHz...1GHz      | 47dB(µV/m) Qpk at 10m      |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   |  |                     |                          | 1...3GHz           | Do not apply               |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   |  |                     |                          | 3...6GHz           | Internal freq. < 108MHz    |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Conducted emissions  | IEC55016            | Input                    | 150kHz...500kHz    | 99dB(µV) Qpk               |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   |  |                     |                          | 500kHz...30MHz     | 93dB(µV) Qpk               |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | <table border="1"> <thead> <tr> <th>Test</th> <th>Norm</th> <th>Port</th> <th>Severity</th> <th>Conditions</th> <th>P</th> </tr> </thead> <tbody> <tr> <td rowspan="2">Electrostatic discharge</td> <td rowspan="2">IEC61000-4-2</td> <td rowspan="2">Case</td> <td>±8kV</td> <td>Air (isolated parts)</td> <td rowspan="2">B</td> </tr> <tr> <td>±8kV</td> <td>Contact (conductive parts)</td> </tr> <tr> <td rowspan="4">Radiated high-frequency</td> <td rowspan="4">IEC61000-4-3</td> <td rowspan="4">X/Y/Z Axis</td> <td>20V/m</td> <td>0.08...1.0GHz M. 80% 1kHz</td> <td rowspan="4">A</td> </tr> <tr> <td>10V/m</td> <td>1.4...2.1GHz M. 80% 1kHz</td> </tr> <tr> <td>5V/m</td> <td>2.1...2.5GHz M. 80% 1kHz</td> </tr> <tr> <td>3V/m</td> <td>5.1...6GHz M. 80% 1kHz</td> </tr> <tr> <td rowspan="4">Fast transients</td> <td rowspan="4">IEC61000-4-4</td> <td>Input</td> <td>±2kV</td> <td rowspan="4">Tr/Th: 5/50 ns</td> <td rowspan="4">A</td> </tr> <tr> <td>Output</td> <td>±2kV</td> </tr> <tr> <td>Signal</td> <td>±2kV</td> </tr> <tr> <td>PE</td> <td>±1kV</td> </tr> <tr> <td rowspan="2">Surge</td> <td rowspan="2">IEC61000-4-5</td> <td>Input L to L</td> <td>±1kV</td> <td rowspan="2">Tr/Th: 1.2/50µs</td> <td rowspan="2">B</td> </tr> <tr> <td>Input L to PE</td> <td>±2kV</td> </tr> <tr> <td rowspan="4">Conducted RF</td> <td rowspan="4">IEC61000-4-6</td> <td>Input</td> <td>10V</td> <td rowspan="4">0.15...80MHz M. 80% 1kHz</td> <td rowspan="4">A</td> </tr> <tr> <td>Output</td> <td>10V</td> </tr> <tr> <td>Signal</td> <td>10V</td> </tr> <tr> <td>PE</td> <td>10V</td> </tr> <tr> <td>Magnetic field</td> <td>IEC61000-4-8</td> <td>X/Y/Z Axis</td> <td>300A/m</td> <td>0Hz, 16.7Hz, 50/60Hz</td> <td>A</td> </tr> <tr> <td>Pulse magnetic field</td> <td>IEC61000-4-9</td> <td>X/Y/Z Axis</td> <td>300A/m</td> <td>Tr/Th: 6.4/16µs</td> <td>B</td> </tr> </tbody> </table> | Test                | Norm                     | Port               | Severity                   | Conditions          | P                  | Electrostatic discharge | IEC61000-4-2 | Case                           | ±8kV                  | Air (isolated parts)            | B                     | ±8kV            | Contact (conductive parts) | Radiated high-frequency | IEC61000-4-3            | X/Y/Z Axis          | 20V/m    | 0.08...1.0GHz M. 80% 1kHz              | A               | 10V/m        | 1.4...2.1GHz M. 80% 1kHz | 5V/m                          | 2.1...2.5GHz M. 80% 1kHz | 3V/m                               | 5.1...6GHz M. 80% 1kHz      | Fast transients                     | IEC61000-4-4 | Input | ±2kV | Tr/Th: 5/50 ns | A | Output | ±2kV | Signal | ±2kV | PE | ±1kV | Surge | IEC61000-4-5 | Input L to L | ±1kV | Tr/Th: 1.2/50µs | B | Input L to PE | ±2kV | Conducted RF | IEC61000-4-6 | Input | 10V | 0.15...80MHz M. 80% 1kHz | A | Output | 10V | Signal | 10V | PE | 10V | Magnetic field | IEC61000-4-8 | X/Y/Z Axis | 300A/m | 0Hz, 16.7Hz, 50/60Hz | A | Pulse magnetic field | IEC61000-4-9 | X/Y/Z Axis | 300A/m | Tr/Th: 6.4/16µs | B |
|  |   | Test   | Norm                | Port                     | Severity           | Conditions                 | P                   |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Electrostatic discharge  | IEC61000-4-2        | Case                     | ±8kV               | Air (isolated parts)       | B                   |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   |  |                     |                          | ±8kV               | Contact (conductive parts) |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Radiated high-frequency  | IEC61000-4-3        | X/Y/Z Axis               | 20V/m              | 0.08...1.0GHz M. 80% 1kHz  | A                   |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   |  |                     |                          | 10V/m              | 1.4...2.1GHz M. 80% 1kHz   |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5V/m   | 2.1...2.5GHz M. 80% 1kHz                              |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 3V/m   | 5.1...6GHz M. 80% 1kHz                                |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| Fast transients  | IEC61000-4-4  | Input  | ±2kV                | Tr/Th: 5/50 ns           | A                  |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Output   | ±2kV                |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Signal   | ±2kV                |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | PE   | ±1kV                |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| Surge  | IEC61000-4-5  | Input L to L   | ±1kV                | Tr/Th: 1.2/50µs          | B                  |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Input L to PE  | ±2kV                |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| Conducted RF   | IEC61000-4-6  | Input  | 10V                 | 0.15...80MHz M. 80% 1kHz | A                  |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Output   | 10V                 |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | Signal   | 10V                 |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | PE   | 10V                 |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| Magnetic field   | IEC61000-4-8  | X/Y/Z Axis   | 300A/m              | 0Hz, 16.7Hz, 50/60Hz     | A                  |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| Pulse magnetic field   | IEC61000-4-9  | X/Y/Z Axis   | 300A/m              | Tr/Th: 6.4/16µs          | B                  |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
|  |   | <b>P=</b> Performance criteria, L= Line, PE= Protective Earth  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4.3.7  | Relative humidity                                     | Up to 95%  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5.1.1.2  | DC power supply range                                 | From 0.70 to 1.25 Un continuous  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5.1.1.3  | Temporary DC power supply fluctuation                 | From 0.60 to 1.40 Un 0.1s<br>From 1.25 to 1.40 Un 1s without damage  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5.1.1.4  | Interruptions of voltage supply                       | Class S1 (without interruptions)   |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5.1.1.6  | Input ripple factor                                   | 10% peak to peak with a DC Ripple Factor of 5 %  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5.1.3  | Supply change-over                                    | 0,6 Un duration 100ms (without interruptions). Performance criterion A   |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 7.2.7  | Input reverse polarity protection                     | By fuse  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 10.7   | Protective coating for PCB assemblies                 | Class PC2  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 13.3   | Tests list  | <table border="0"> <tr><td>1 Visual Inspection</td><td>Routine</td></tr> <tr><td>2 Performance test</td><td>Routine</td></tr> <tr><td>3 Power supply test</td><td>Routine</td></tr> <tr><td>4 Insulation test</td><td>Routine</td></tr> <tr><td>5 Low temperature storage test</td><td>-</td></tr> <tr><td>6 Low temperature start-up test</td><td>Type</td></tr> <tr><td>7 Dry heat test</td><td>Type</td></tr> <tr><td>8 Cyclic damp heat test</td><td>Type</td></tr> <tr><td>9 Salt mist test</td><td>-</td></tr> <tr><td>10 Enclosure protection test (IP code)</td><td>-</td></tr> <tr><td>11 EMC test</td><td>Type</td></tr> <tr><td>12 Shocks and vibrations test</td><td>Type</td></tr> <tr><td>13 Equipment stress screening test</td><td>Routine: 40°C and load 100%</td></tr> <tr><td>14 Rapid Temperature variation test</td><td>Type</td></tr> </table>   | 1 Visual Inspection | Routine                  | 2 Performance test | Routine                    | 3 Power supply test | Routine            | 4 Insulation test       | Routine      | 5 Low temperature storage test | -                     | 6 Low temperature start-up test | Type                  | 7 Dry heat test | Type                       | 8 Cyclic damp heat test | Type                    | 9 Salt mist test    | -        | 10 Enclosure protection test (IP code) | -               | 11 EMC test  | Type                     | 12 Shocks and vibrations test | Type                     | 13 Equipment stress screening test | Routine: 40°C and load 100% | 14 Rapid Temperature variation test | Type         |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 1 Visual Inspection  | Routine   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 2 Performance test   | Routine   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 3 Power supply test  | Routine   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 4 Insulation test  | Routine   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 5 Low temperature storage test   | -   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 6 Low temperature start-up test  | Type  |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 7 Dry heat test  | Type  |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 8 Cyclic damp heat test  | Type  |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 9 Salt mist test   | -   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 10 Enclosure protection test (IP code)                                 | -   |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 11 EMC test  | Type  |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 12 Shocks and vibrations test  | Type  |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 13 Equipment stress screening test                                     | Routine: 40°C and load 100%                           |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |
| 14 Rapid Temperature variation test                                    | Type  |  |                     |                          |                    |                            |                     |                    |                         |              |                                |                       |                                 |                       |                 |                            |                         |                         |                     |          |  |                 |              |                          |                               |                          |                                    |                             |                                     |              |       |      |                |   |        |      |        |      |    |      |       |              |              |      |                 |   |               |      |              |              |       |     |                          |   |        |     |        |     |    |     |                |              |            |        |                      |   |                      |              |            |        |                 |   |



## ANNEXE-2

| Applicable values for the different sections of the norm RIA12 |                            |               |          |                  |
|--|----------------------------|---------------|----------|------------------|
|  | Type of disturbance        | Voltage level | Duration | Source impedance |
| 5.2  | Supply related surge       | 3.5 x Vin nom | 20 ms    | 0.2 Ω            |
|  |                            | 1.5 x Vin nom | 1 s      | 0.2 Ω            |
| 5.3  | Direct transient           | 800 V         | 100 μs   | 5 Ω              |
|  |                            | 1500 V        | 50 μs    | 5 Ω              |
|  |                            | 3000 V        | 5 μs     | 100 Ω            |
|  |                            | 4000 V        | 1 μs     | 100 Ω            |
|  |                            | 7000 V        | 0.1 μs   | 100 Ω            |
| 5.4  | Indirect coupled transient | 1500 V        | 50 μs    | 100 Ω            |
|  |                            | 3000 V        | 5 μs     | 100 Ω            |
|  |                            | 4000 V        | 1 μs     | 100 Ω            |
|  |                            | 7000 V        | 0.1 μs   | 100 Ω            |

## ANNEXE-3

| Applicable values for the different sections of the norm EN50160: 2022 |  |               |                       |
|--|--|---------------|-----------------------|
|  |  | EN50160 limit | Product               |
| 4.2.1  | Power frequency for systems with no synchronous connection to an interconnected system | < ±2%         | < ± 0.5% (50 ±0.25Hz) |
| 4.2.2  | Supply voltage variations  | < ± 10%       | +2%, -5%              |
| 4.2.5  | Harmonic voltage   | < 8% THD      | < 2% THD              |