

K-No.: 15101	5-25A Current-Sensor-Module For the electronic measurement of currents: DC, AC, pulsed, mixed ..., with a galvanic isolation between the primary circuit (high power) and the secondary circuit (electronic circuit)	Date: 26.10.2007
--------------	---	------------------

Customer: Standard Type	Customers Part No.:	Page 1 of 3
-------------------------	---------------------	-------------

Description	Characteristics	Applications
- Closed loop (compensation) - Current Sensor with magnetic field probe - Printed circuit board mounting - Casing and materials UL-listed	- Excellent accuracy - Very low offset current - Very low temperature dependency and offset current drift - Very low hysteresis of offset current - Short response time - Wide frequency bandwidth - Compact design	Mainly used for stationary operation in industrial applications: - AC variable speed drives and servo motor drives - Static converters for DC motor drives - Battery supplied applications - Switched Mode Power Supplies (SMPS) - Power Supplies for welding applications - Uninterruptable Power Supplies (UPS)

Electrical Data – Ratings

I_{PN}	Primary rated current, r.m.s	25	A
R_M	Load resistance	0 ... 200	Ω
I_{SN}	Output rated current, r.m.s	12.5	mA
K_N	Turns ratio	1...3 : 2000	

Accuracy – Dynamic performance data (with DRV401 @ $V_C = 5V \pm 5\%$)		min.	typ	max.	Unit
$I_{P,max}$	Max. measuring range @ $R_M = 12,5 \Omega$	± 85			A
$X(T)$	Measuring accuracy @ $I_{PN}, T_A = -40... +85^\circ C$			0.5	%
ϵ_L	Linearity			0.1	%
$I_0(T)$	Offset current @ $I_P=0, T_A = -40... +85^\circ C$		0.02	0.05	mA
I_{0H}	Hysteresis		0.02	0.05	mA
t_r	Response time		0.5		μs
$\Delta t(I_{P,max})$	Delay time at $di/dt = 100 A/\mu s$		0.2		μs
f	Frequency range	DC...100			kHz

General Data		min.	typ.	max.	Unit
T_A	Ambient temperature	-40		+85	$^\circ C$
T_S	Storage temperature	-40		+90	$^\circ C$
m	Mass		15		g
R_S	Secondary coil resistance @ $T_A=85^\circ C$			80	Ω
R_P	Primary coil resistance per turn @ $T_A=25^\circ C$		1		m Ω
C_k	Coupling capacity		5		pF
Mechanical Stress according to M3209/3				10g	
Settings: 10 – 2000 Hz, 1 min/Decade, 2 hours					
Constructed and manufactured and tested in accordance with EN 61800-5-1 (Pin 1 - 6 to Pin 7 – 10)					
Reinforced insulation, Insulation material group 1, Pollution degree 2					
S_{clear}	clearance (component without solder pad)	10.2			mm
S_{creep}	creepage (component without solder pad)	10.2			mm
V_{sys}	System voltage overvoltage category 3	RMS		600	V
V_{work}	Working voltage (table 7 acc. to EN61800-5-1)	RMS		1020	V
U_{PD}	Rated discharge voltage	peak value		1414	V

Type Testing according to EN 61800-5-1 (Pin 1 - 6 to Pin 7 - 10)

V_W	HV transient test according to M3064 (1,2 μs / 50 μs -wave form)		8	kV
V_d	Testing voltage to M3014	(5 s)	3.6	kV
V_e	Partial discharge voltage acc.M3024 (RMS)		1500	V
	with V_{vor} (RMS)		1875	V

Datum	Name	Index	Änderung
		81	

Hrsg.: KB-E editor	Bearb: SA designer	KB-E: Le check	KB-PM IA: KRe. check	freig.: prs. released
-----------------------	-----------------------	-------------------	-------------------------	--------------------------

K-No.: 15101

5-25A Current-Sensor-Module

For the electronic measurement of currents:
DC, AC, pulsed, mixed ..., with a galvanic Isolation
between the primary circuit (high power) and
the secondary circuit (electronic circuit)

Date: 26.10.2007


Customer: Standard Type

Cutomers Part No.:

Page 2 of 3

Mechanical outline (mm):

General tolerances DIN ISO 2768-c

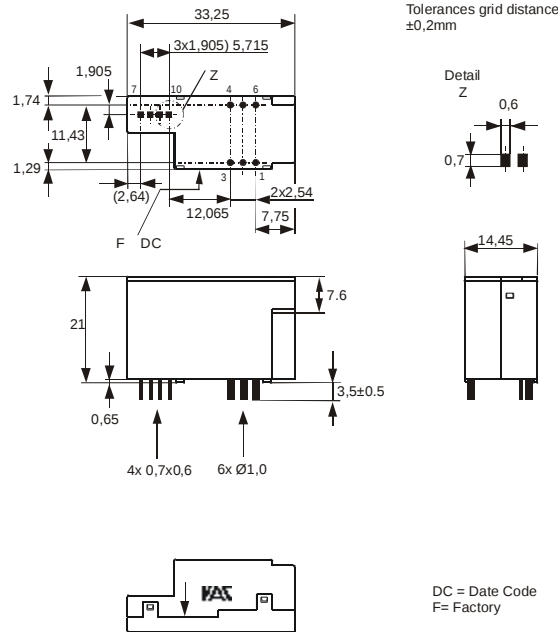


Connections:
1...6: Ø 1.0 mm
7..10: 0.7*0.6 mm

Marking:

VAC
4645X400
F DC

Schematic diagram

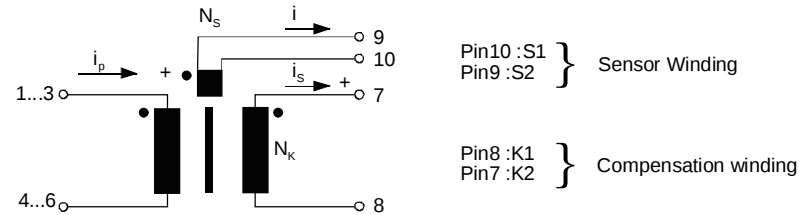

Inspection (Measurements after temperature balance of the samples at room temperature.)

K_N (N1/N2)	(V)	M3011/6c:	Turns ratio ($I_p=3^*8A$, 40...80 Hz)	3 : 2000 ± 0,5	%
I_0		M3226:	Offset current	< 0.05	mA
$\Delta\Phi$ (K1-K2)	(V)	M3090:	Magnetic Flux compensation core	4,5...7	nVs
$\Delta\Phi$ (S1-S2)	(V)	M3090:	Magnetic Flux sensor	20...35	nVs
R_s (K1-K2)	(V)	M3011/5:	Winding resistance compensation coil	52...60	Ω
R (S1-S2)	(V)	M3011/5:	Winding resistance magnetic probe coil	2.3...3.0	Ω
V_d	(V)	M3014:	Testing voltage, rms, 1s	1.8	kV
V_e	(AQL1/S4)	M3024:	Partial discharge voltage (RMS)	>1500	V
			with V_{vor} (RMS)	1875	V

Applicable documents

Current direction: A positive output current appears at point I_s , by primary current in direction of the arrow.
Temperature of the primary conductor should not exceed 110°C
Housing and bobbin material: UL-listed. Flammability class UL 94V-0.
Enclosures according to IEC 60529: IP50.

Additional data available on request.
This specification is no declaration of warranty acc. BGB §443.

Hrsg.: KB-E
editor

Bearb: SA
designer

KB-E: Le
check

KB-PM IA: KRe.
check

freig.: prs.
released

K-No.: 15101	5-25A Current-Sensor-Module For the electronic measurement of currents: DC, AC, pulsed, mixed ..., with a galvanic Isolation between the primary circuit (high power) and the secondary circuit (electronic circuit)	Date: 26.10.2007
--------------	---	------------------

Customer: Standard Type	Cutomers Part No.:	Page 3 of 3
-------------------------	--------------------	-------------

Explanation of several of the terms used in the tablets (in alphabetical order)

I_{0H} :	Zero variation of I_0 after overloading with a DC of tenfold the rated value ($R_M = R_{MN}$)
I_{0t} :	Long term drift of I_0 after 100 temperature cycles in the range -40 bis 85 °C.
t_r :	Response time (describe the dynamic performance for the specified measurement range), measured as delay time at $I_P = 0,9 \cdot I_{Pmax}$ between a rectangular current and the output current.
$\Delta t (I_{Pmax})$:	Delay time (describe the dynamic performance for the rapid current pulse rate e.g short circuit current) measured between I_{Pmax} and the output current i_a with a primary current rise of $di_1/dt = 100 A/\mu s$.
U_{PD}	Rated discharge voltage (recurring peak voltage separated by the insulation) proved with a sinusoidal voltage V_e $U_{PD} = \sqrt{2} \cdot V_e / 1,5$
V_{vor}	Defined voltage is the RMS valve of a sinusoidal voltage with peak value of $1,875 \cdot U_{PD}$ required for partial discharge test in IEC 61800-5-1 $V_{vor} = 1,875 \cdot U_{PD} / \sqrt{2}$
V_{sys}	System voltage RMS value of rated voltage according to IEC 61800-5-1
V_{work}	Working voltage voltage according to IEC 61800-5-1 which occurs by design in a circuit or across insulation
$X_{ges}(I_{PN})$:	The sum of all possible errors over the temperature range by measuring a current I_{PN} : $X_{ges} = 100 \cdot \left \frac{I_S(I_{PN})}{K_N \cdot I_{SN}} - 1 \right \%$
X :	Permissible measurement error in the final inspection at RT, defined by $X = 100 \cdot \left \frac{I_{SB}}{I_{SN}} - 1 \right \%$ where I_{SB} is the output DC value of an input DC current of the same magnitude as the (positive) rated current ($I_0 = 0$)
X_{Ti} :	Temperature drift of the rated value orientated output term. I_{SN} (cf. Notes on F_i) in a specified temperature range, obtained by: $X_{Ti} = 100 \cdot \left \frac{I_{SB}(T_{A2}) - I_{SB}(T_{A1})}{I_{SN}} \right \%$
ϵ_L :	Linearity fault defined by $e_L = 100 \cdot \left \frac{I_P}{I_{PN}} - \frac{I_{Sx}}{I_{SN}} \right \%$ Where I_P is any input DC and I_{Sx} the corresponding output term. I_{SN}: see notes of F_i ($I_0 = 0$).

This “Additional information“ is no declaration of warranty according BGB §443

Hrsg.: KB-E editor	Bearb: SA designer		KB-E: Le check	KB-PM IA: KRe. check		freig.: prs. released
-----------------------	-----------------------	--	-------------------	-------------------------	--	--------------------------